
NOTES:

- "A" MINIMUM OFFSETS SHALL BE 5 FEET FROM THE BACK OF CURB OR THE EDGE OF PAVEMENT.
- "B" MINIMUM DEPTH FROM TOP OF CONDUIT OR CASING TO TOP OF PAVEMENT FOR ALL STREETS IS 48". MINIMUM DEPTH OF 12" BELOW THE UNDERDRAIN IS REQUIRED FOR ALL STREETS.
- "C" IF AGGREGATE DRAINS ARE DISTURBED, THEY MUST BE REPLACED.



TYPICAL LOCATION FOR NON-CURBED STREETS

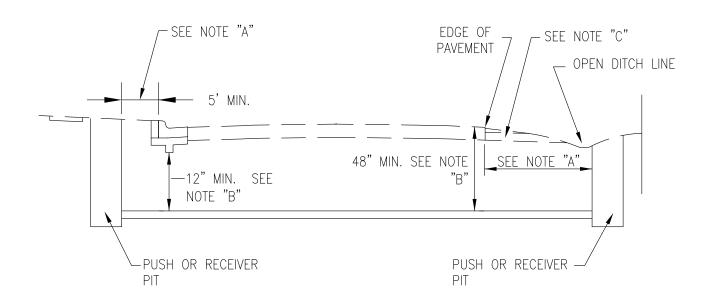

	ounty Engineer		
Delaware County Engineer			
APPROVED	REVISED		
1-22-2008	1-04-2010		

STANDARD CONSTRUCTION DRAWING

TYP. UTILITY BORE REQUIREMENTS

DELAWARE COUNTY ENGINEER'S OFFICE 50 Channing Street

Drawn	<u>KS</u>	sheet.	2	FILE NO.
Checked	EM	of .	2	DCED-R2166B