


END TREATMENT AT ENDWALL

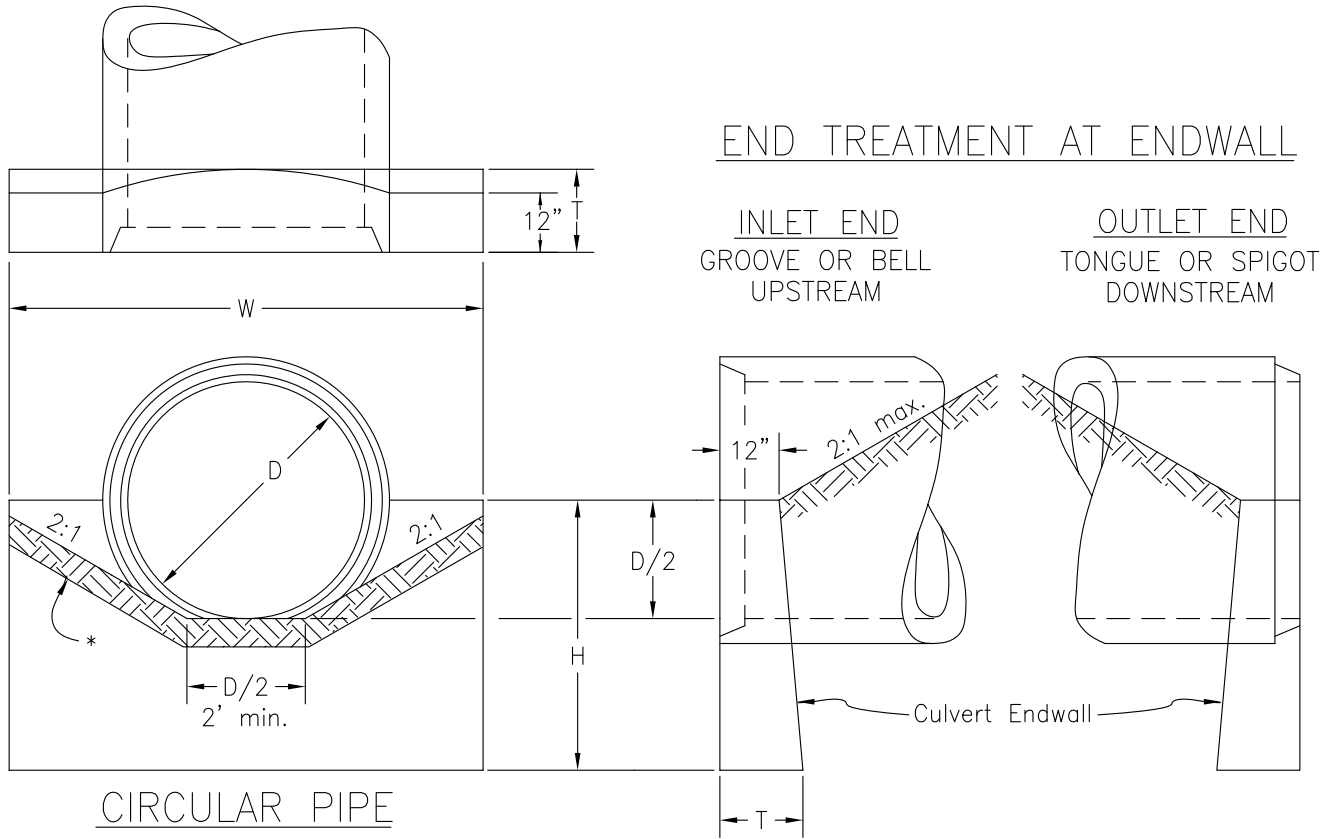

*TOP SURFACE OF 6" INLET
HEADWALL EXTENSION

For additional channel protection
details, see Standard Drawing
DCED-S176.

- NOTES:** Concrete shall be Class "C".
 If pipe is to be extended in the future the endwall shall be set back 6".
 Dimensions and quantities are shown for concrete sections only. When used with
 other pipe materials it will be necessary to determine such dimensions and quantities.
 Cast in place endwalls shall not be used unless approved by the County Engineer.

CHRIS E. BAUSERMAN, P.E., P.S. Delaware County Engineer <hr/> <i>Delaware County Engineer</i>	STANDARD CONSTRUCTION DRAWING CAST IN PLACE PIPE CULVERT ENDWALLS	DELAWARE COUNTY ENGINEER'S OFFICE 50 Channing Street Delaware, Ohio 43015 PHONE: (740)833-2400 FAX: (740)833-2399 www.co.delaware.oh.us
APPROVED 1-22-2008	REVISED 1-04-2010	Drawn <u>KS</u> sheet <u>1</u> FILE NO. Checked <u>EM</u> of <u>2</u> DCED-S165A